


LIQUID SERVICE

**PITOT TUBE INSTALLATION
and WIRING DIAGRAM
for D/P TRANSMITTER**

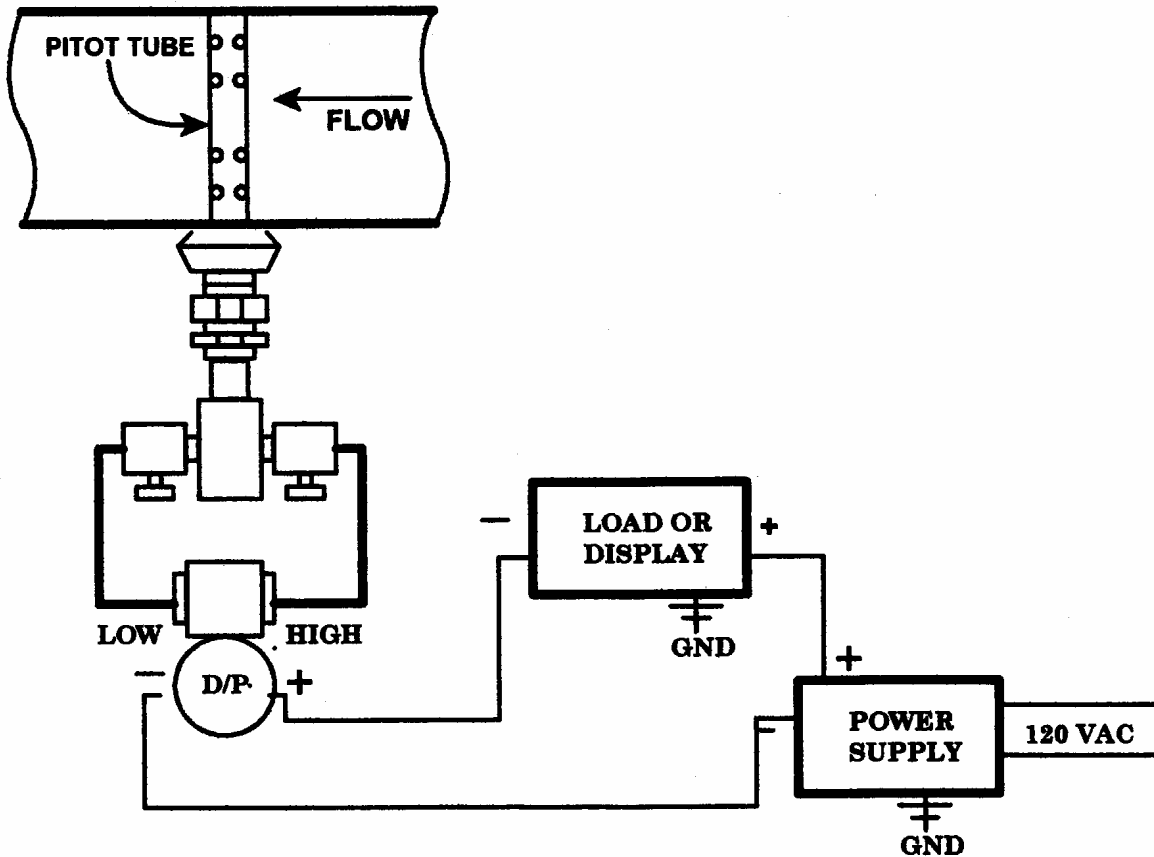

THE D/P TRANSMITTER SHOULD BE LOCATED BELOW THE PITOT TUBE. THE SIGNAL LINES SHOULD HAVE AT LEAST 1" OR MORE PER FOOT DOWN SLOPE FROM THE SENSOR VALVES TO THE TRANSMITTER.