


**SYSTEMS for INDUSTRY
DETROIT, MICHIGAN**

**PITOT TUBE INSTALLATION
AND WIRING DIAGRAM
FOR D/P TRANSMITTER**

**LIQUID SERVICE
INSTALLATION DRAWING
FOR SENSOR AND
TRANSMITTER**

DOWN FLOW

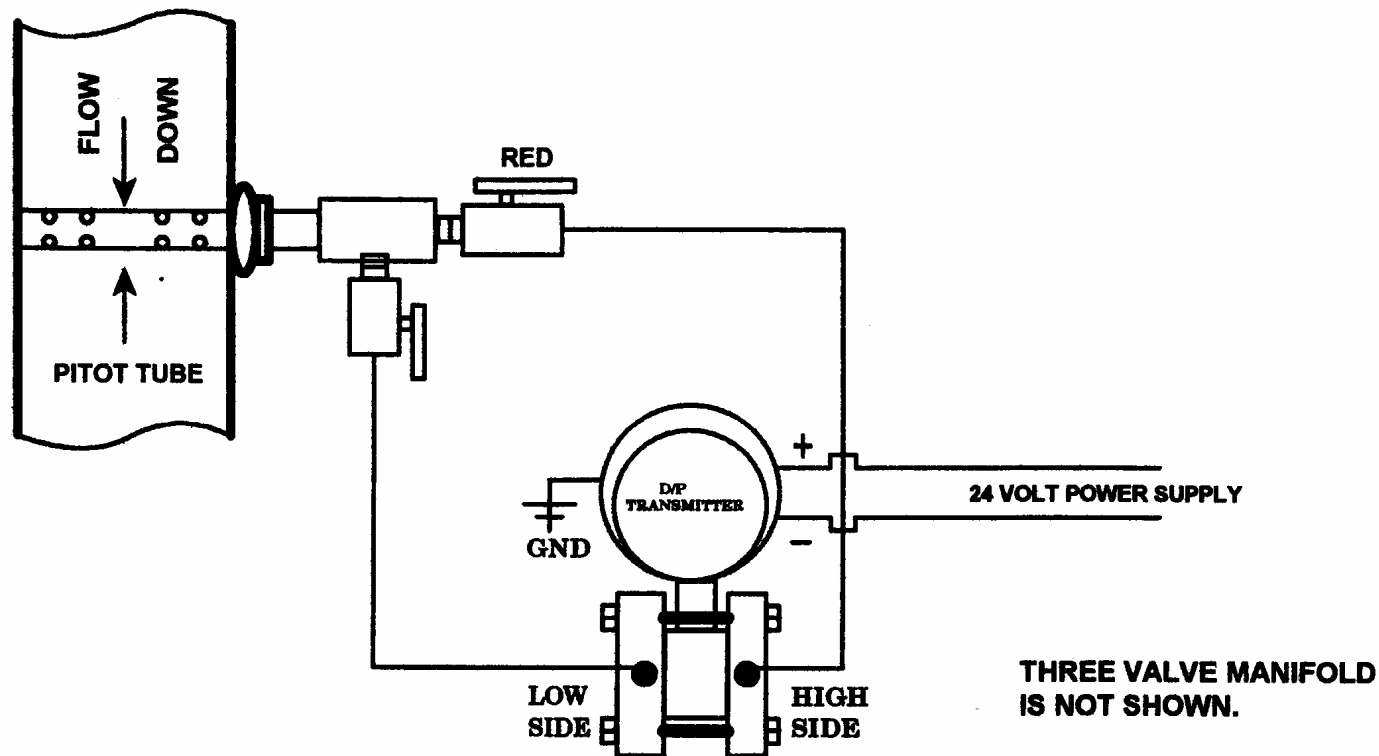

**THE TRANSMITTER SHOULD BE LOCATED
BELOW THE SENSOR, AND THE SIGNAL LINES
SHOULD HAVE AT LEAST 1" PER FOOT DOWN
SLOPE.**