


**SYSTEMS for INDUSTRY  
DETROIT, MICHIGAN**

**PITOT TUBE INSTALLATION  
AND WIRING DIAGRAM  
FOR D/P TRANSMITTER**

**LIQUID SERVICE  
INSTALLATION DRAWING  
FOR SENSOR AND  
TRANSMITTER**

**UP FLOW**

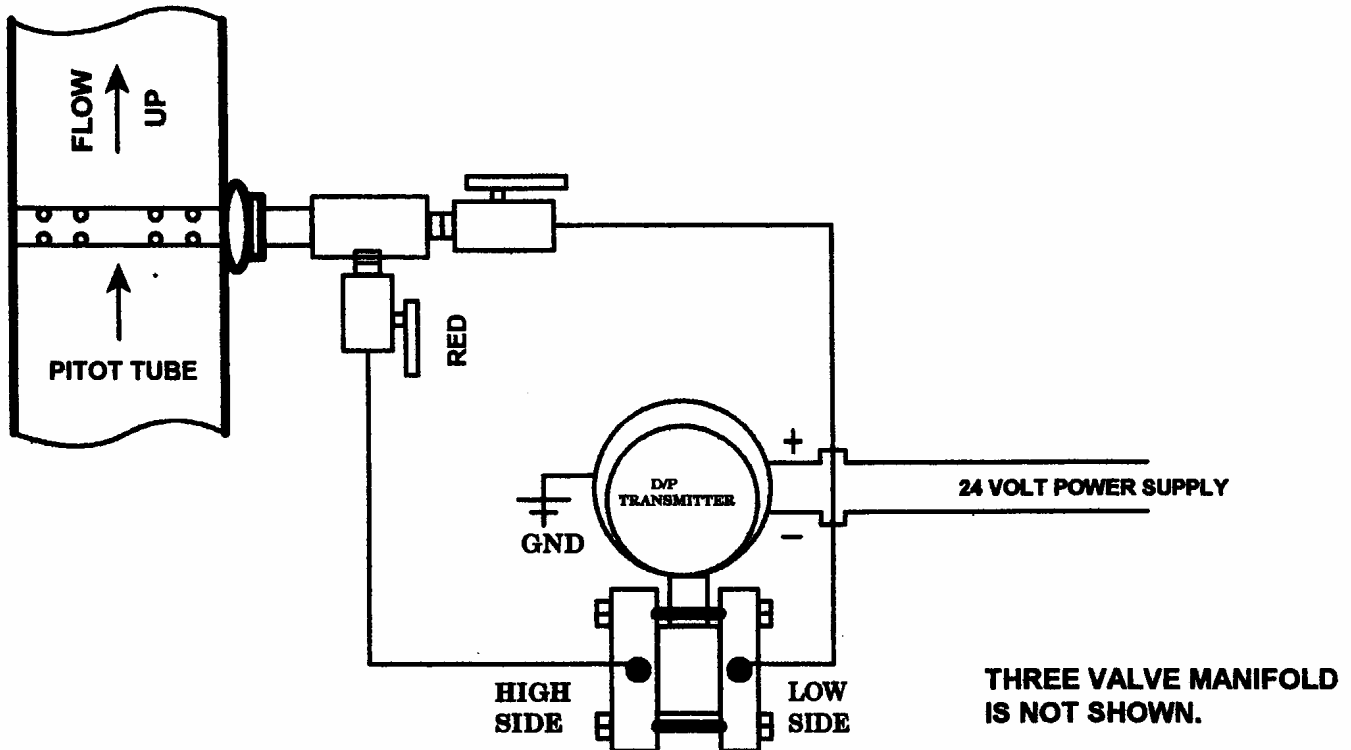

**THE TRANSMITTER SHOULD BE LOCATED  
BELOW THE SENSOR, AND THE SIGNAL LINES  
SHOULD HAVE AT LEAST 1" PER FOOT DOWN  
SLOPE.**